

TYPICAL DRAINAGE & WATERMAIN
ARRANGEMENT AROUND DWELLINGS
SCALE 1:100

GENERAL NOTES


- THIS DRAWING SHOULD BE READ IN CONJUNCTION WITH ALL RELEVANT ENGINEERS AND ARCHITECTS DRAWINGS AND SPECIFICATIONS.
- ALL LEVELS ARE IN METRES TO ORDNANCE DATUM, MAJIN HEAD UNLESS NOTED OTHERWISE.
- THE POSITION OF EXISTING SERVICES AS SHOWN ON THE DRAWING MAY NOT BE ACCURATE. THE CONTRACTOR SHALL BE FULLY RESPONSIBLE FOR LOCATING ALL EXISTING SERVICES ON THE SITE AND SHOULD CONTACT THE RESPECTIVE UTILITY PROVIDERS AND AUTHORITIES FOR THE MOST UP-TO-DATE INFORMATION BEFORE COMMENCING THE WORKS.
- EXISTING LEVELS ARE INDICATIVE ONLY AND MUST BE CHECKED AND VERIFIED ON SITE PRIOR TO COMMENCEMENT.
- PROPOSED MANHOLE COVER LEVELS ARE APPROXIMATE AND SHOULD BE ADJUSTED TO SUIT LOCAL FINISHES.
- ALL SURFACE WATER DRAINAGE INFRASTRUCTURE SHALL BE CONSTRUCTED IN ACCORDANCE WITH LOCAL AUTHORITY REQUIREMENTS.
- LOCKABLE TYPE GULLY TRAPS TO BE USED ON ALL SURFACE WATER DRAINS.
- GULLY POSITIONS ARE APPROXIMATE ONLY AND SHOULD BE LOCATED AT LOW POINTS.
- REFER TO ARCHITECTS DRAWINGS FOR ALL ROOF DRAINAGE, STRIP DRAINS AND GULLY TRAPS BENEATH DOWNPIPES.
- WHERE IT IS NOT POSSIBLE TO ACHIEVE MINIMUM COVER, PIPES SHOULD BE REDDED AND SURROUNDING IN CONCRETE 150mm THICK, CLASS E IN ACCORDANCE WITH TI STANDARD CONSTRUCTION DETAIL CC-SCD-00521.
- ALL WASTEWATER DRAINAGE INFRASTRUCTURE SHALL BE CONSTRUCTED IN ACCORDANCE WITH IRISH WATER STANDARDS. REFER TO IRISH WATER PUBLICATIONS 'WATER INFRASTRUCTURE STANDARD DETAILS - IW-CDS-5020-01' AND 'CODE OF PRACTICE FOR WASTEWATER INFRASTRUCTURE - IW-CDS-5020-03'.
- HYDRANTS TO BE ACCORDANCE WITH IRISH WATER STANDARD DETAILS STD-W-18 TO STD-W-19.
- THURST BLOCK ARRANGEMENTS SHALL COMPLY WITH IRISH WATER STANDARD DETAILS STD-W-38.
- REFER TO MECHANICAL AND ELECTRICAL ENGINEER'S DRAWINGS FOR INTERNAL DRAINAGE AND DETAILS OF SOIL AND VENT PIPES LEADING TO WASTEWATER DRAINAGE.
- ALL WATER INFRASTRUCTURE SHALL BE CONSTRUCTED IN ACCORDANCE WITH IRISH WATER STANDARDS. REFER TO IRISH WATER PUBLICATIONS 'WATER INFRASTRUCTURE STANDARD DETAILS - IW-CDS-5020-01' AND 'CODE OF PRACTICE FOR WATER INFRASTRUCTURE - IW-CDS-5020-03'.
- ALL PLANTING & TREES TO COMPLY WITH SEPARATION DISTANCES AS PER IRISH WATER STANDARD DETAILS FOR WASTEWATER, STD-WW-06 AND STD-WW-06A AND FOR WATER, STD-W-12 AND STD-W-12A.
- A METHOD STATEMENT SHALL BE SUBMITTED FOR APPROVAL PRIOR TO INSTALLATION AND TESTING.
- ALL PIPE DIAMETERS INDICATED ARE INNER DIAMETER.
- THESE DRAWINGS ARE NOT TO BE USED FOR SETTING OUT PURPOSES. REFER TO ARCHITECTS DRAWINGS FOR SETTING OUT.

CIVIL SERVICES LEGEND

- EXISTING SURFACE WATER PIPES
- PROPOSED PVC FOUL SEWER PIPES (IN ACCORDANCE WITH SECTION 1.13 OF IRISH WATER CODE OF PRACTICE FOR PIPE MATERIALS)
- EXISTING FOUL SEWER PIPES
- BOUNDARY LINE
- PROPOSED SURFACE WATER MANHOLE
- PROPOSED FOUL SEWER MANHOLE (IN ACCORDANCE WITH IRISH WATER TYPICAL DETAILS STD-WW-10/10A/11)
- EXISTING MANHOLE
- ROAD GULLY
- PROPOSED OVERFLOW CHAMBER
- FLUSH KERB TO FACILITATE RUN-OFF TO SWALE
- PROPOSED ATTENUATION TANK (SEE DRAWING No. 421 FOR DETAILS)
- PROPOSED PERMEABLE PAVING AT PRIVATE PARKING BAYS
- PRIVATE SIDE FOUL SEWER INSPECTION CHAMBER (IN ACCORDANCE WITH IRISH WATER STANDARD DETAIL STD-WW-13)
- STORM WATER INSPECTION CHAMBER
- C.L. COVER LEVEL
- I.L. INVERT LEVEL

NOTES:
ALL LEVELS RELATE TO MAJIN HEAD DATUM.

NOTE:
FOR BOTH FOUL SEWER AND STORMWATER DRAINAGE PIPE INFORMATION REFER TO DRAWING No. 241139-ORS-ZZ-XX-DR-CE-415

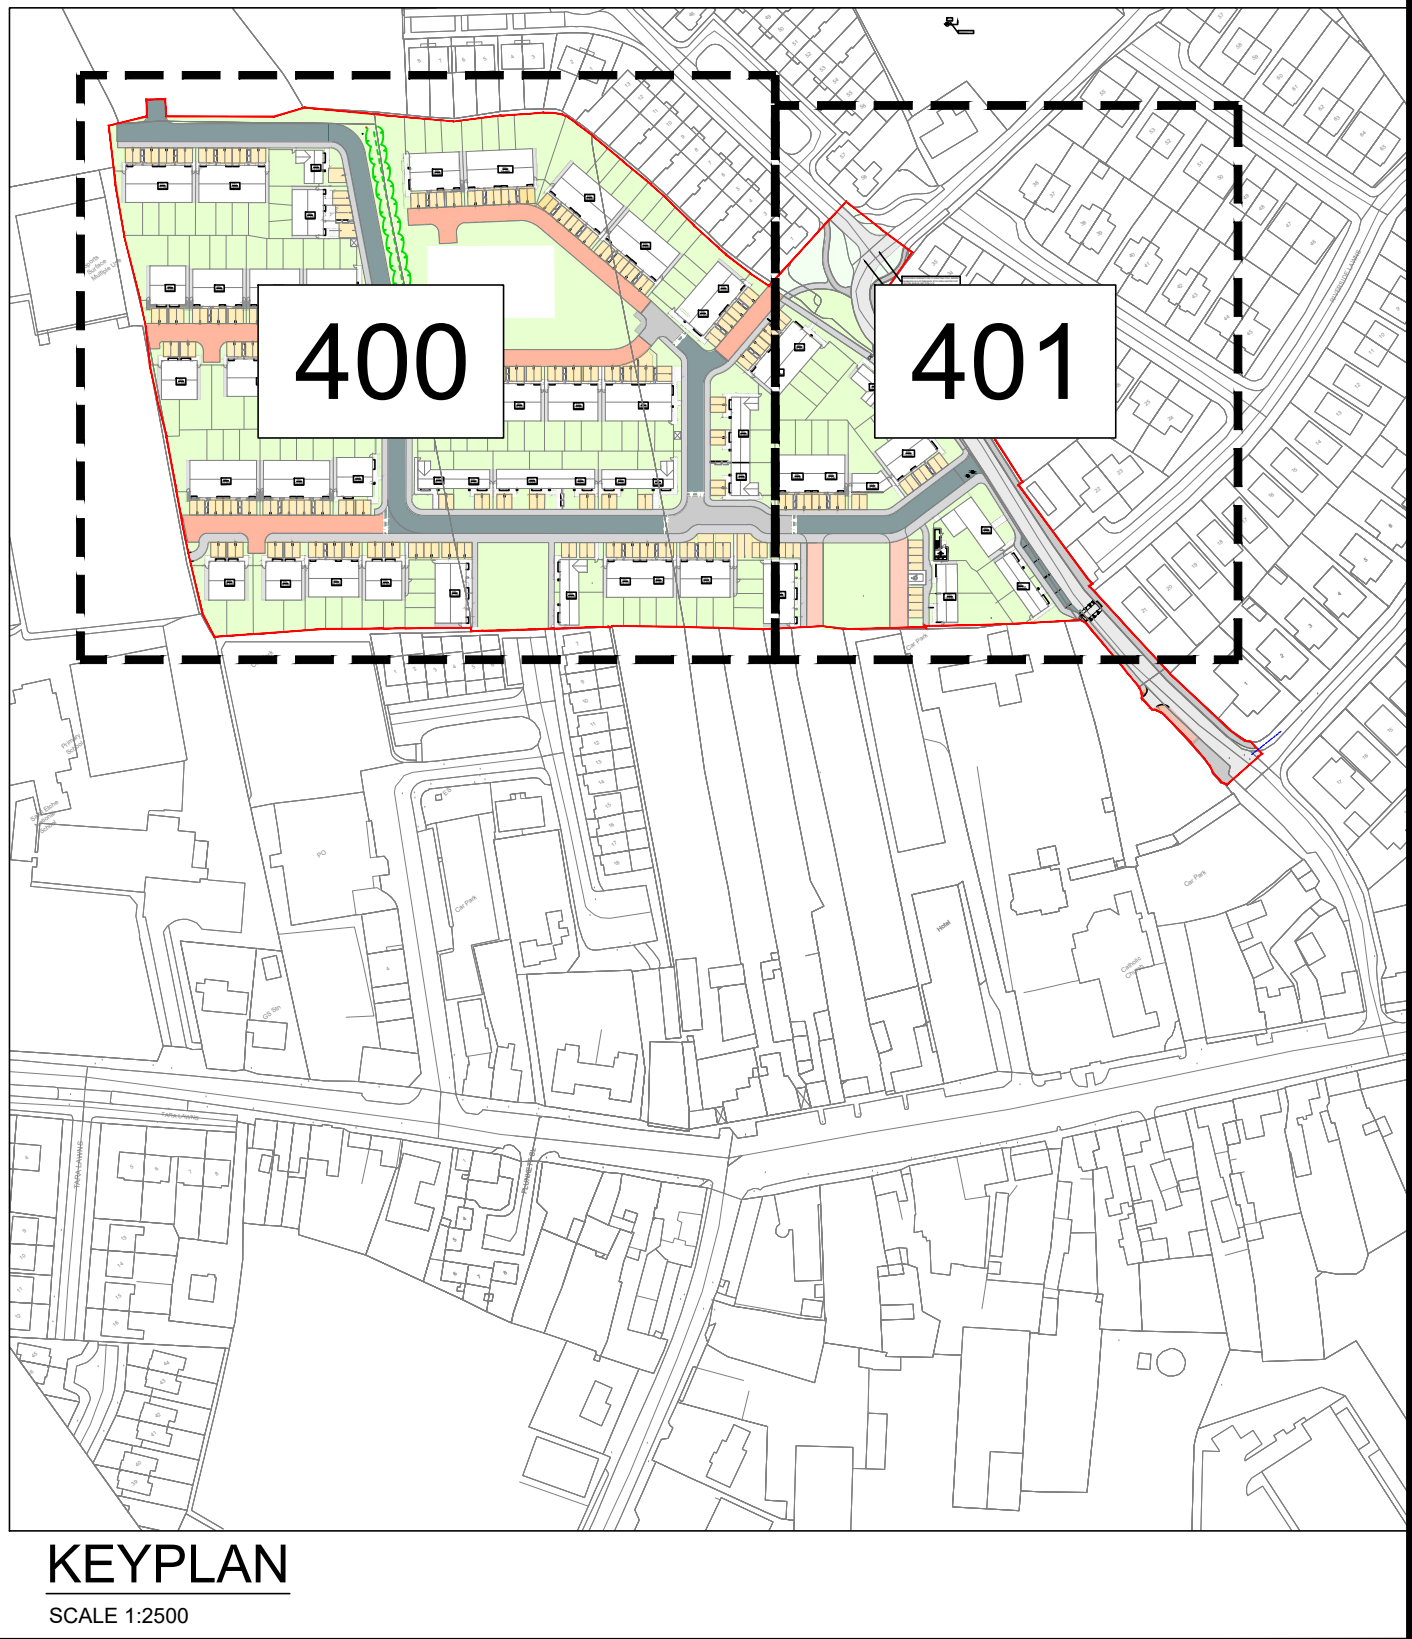

INFORMATION			
© ORS This drawing and any design herein is the copyright of the Consultants and must not be reproduced without their written consent. All drawings remain the property of the Consultants. Figured dimension only to be taken from this drawing. All dimensions to be checked on site. Consultants to be informed immediately of any discrepancies before work proceeds.			
REV NO.	DATE	REVISION NOTE	DWN BY: CND BY:
P01	26/02/2025	ISSUED FOR PRE-PLANNING STAGE 2 (S247)	JG DG
P02	12/03/2025	ISSUED TO IRISH WATER	RS DG
P03	14/03/2025	ISSUED FOR INFORMATION	RS DG
P04	21/03/2025	PRELIMINARY PLANNING PACK	PM DG
P05	02/04/2025	ISSUED FOR PLANNING	PM DG
P06	22/04/2025	IW SODA RESPONSE	PM DG
P07	30/04/2025	IW SODA RESPONSE - ADDITIONAL COMMENTS	PM DG
P08	01/05/2025	IW SODA RESPONSE - ADDITIONAL COMMENTS	PM DG
P09	02/05/2025	ISSUED FOR PLANNING	PM DG

CLIENT:	JH KINNIE LTD.
PROJECT:	HOUSING DEVELOPMENT AT KINNEGAD, Co. WESTMEATH.
TITLE:	FOUL & STORMWATER SEWER LAYOUT PLAN SHEET 2
DRAWN:	PM
CHECKED:	MH
APPROVED:	DG
DATE:	MARCH 2025
SCALE:	1:250
JOB NO:	241139
DRAWING NO:	241139-ORS-ZZ-00-DR-CE-401
REV:	P09

ORS

Mullingar | Dublin | Galway | Donegal | Cork | Waterford

T +353 1 5242060 | W www.ors.ie | E info@ors.ie

ISO 9001:2015 QUALITY ASSURED COMPANY